


MWRA / MDC is out of the Public Health Mainstream


Of 10,000 surface water systems, only 135 met filtration avoidance.

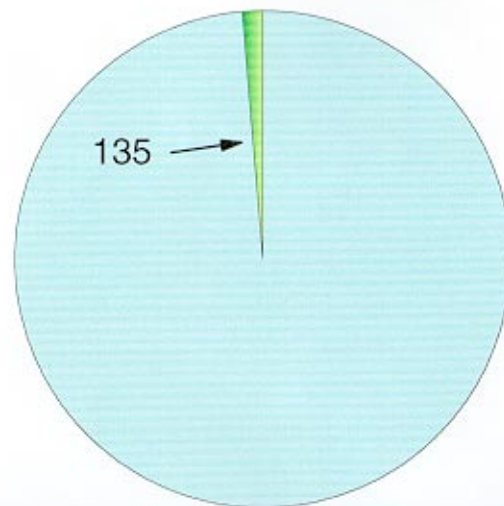

(10,000) Total Number of Surface Water Systems

4 systems (2%) were put on a schedule for filtration

7 systems (3%) met avoidance criteria

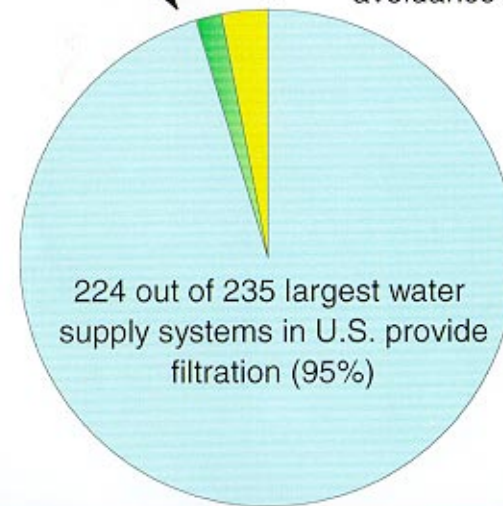

Surface Water Systems serving > 100,000